


HARMSCO®

Cooling Tower Utilizing Hurricane® Filter

Hurricane® Filter Installation

Open Loop Cooling Tower

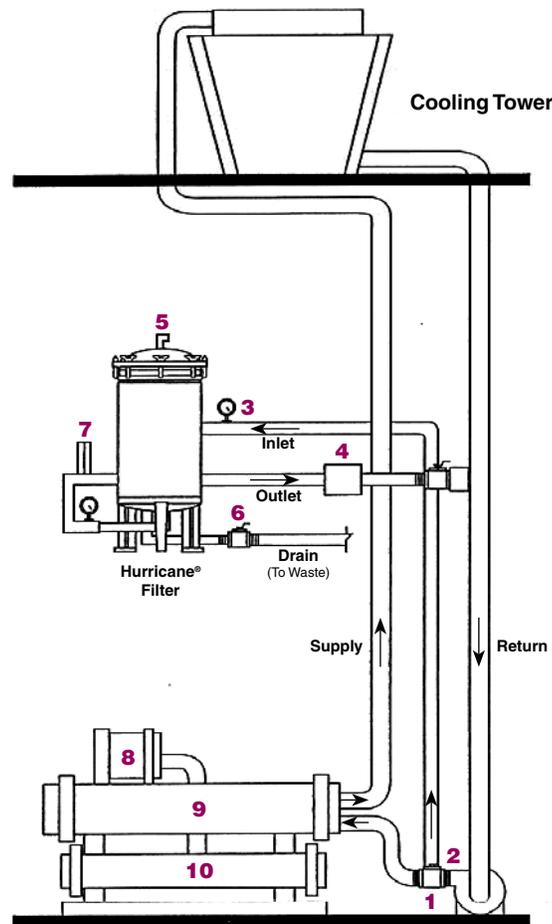

- | | | | |
|----|---|-----|-----------------------|
| 1. | 2-1/2" Thread-let | 6. | Ball valve (typical) |
| 2. | 2-1/2" Full-flow ball valve with 3" nipple on inlet | 7. | Flow meter (optional) |
| 3. | Pressure gauge | 8. | Compressor (existing) |
| 4. | Check valve | 9. | Condenser (existing) |
| 5. | 1/4" MPT petcock or 1/4" plug | 10. | Evaporator (existing) |

Note: This publication is to be used as a guide. The data within has been obtained from many sources and is considered to be accurate. Harmsco does not assume liability for the accuracy and/or completeness of this data. Changes to the data can be made without notification. Temperature, Pressure, Flow Rates, Differential Pressures, Chemical Combinations and other unknown factors can affect performance in unknown ways. **Limited Warranty:** Harmsco warrants their products to be free of material and workmanship defects. Determination of suitability of Harmsco products for uses and applications contemplated by Buyer shall be the sole responsibility of Buyer. The end user/installer/buyer shall be liable for the product's performance and suitability regarding their specific intended applications. End users should perform their own tests to determine suitability for each application.